



PROPERTY OWNER'S RESPONSIBILITY FROM WATER MAIN EXCEPT FOR WATER METER

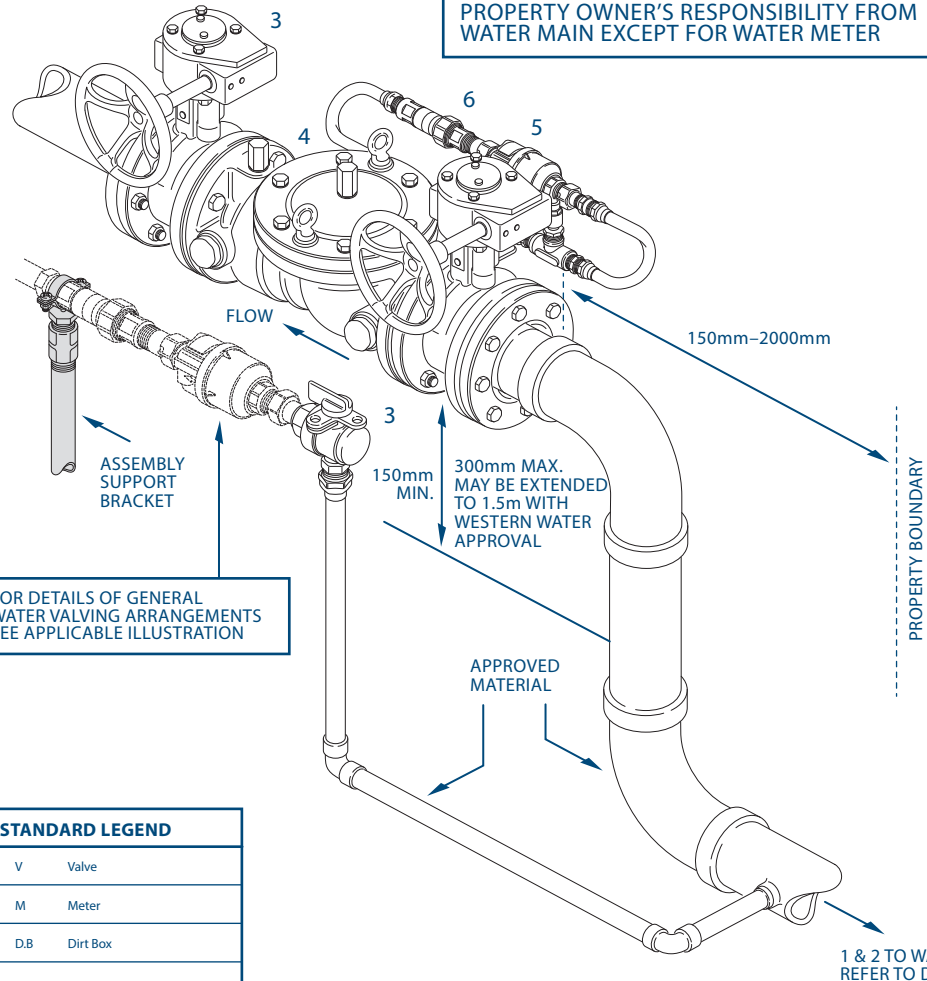

FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE APPLICABLE ILLUSTRATION

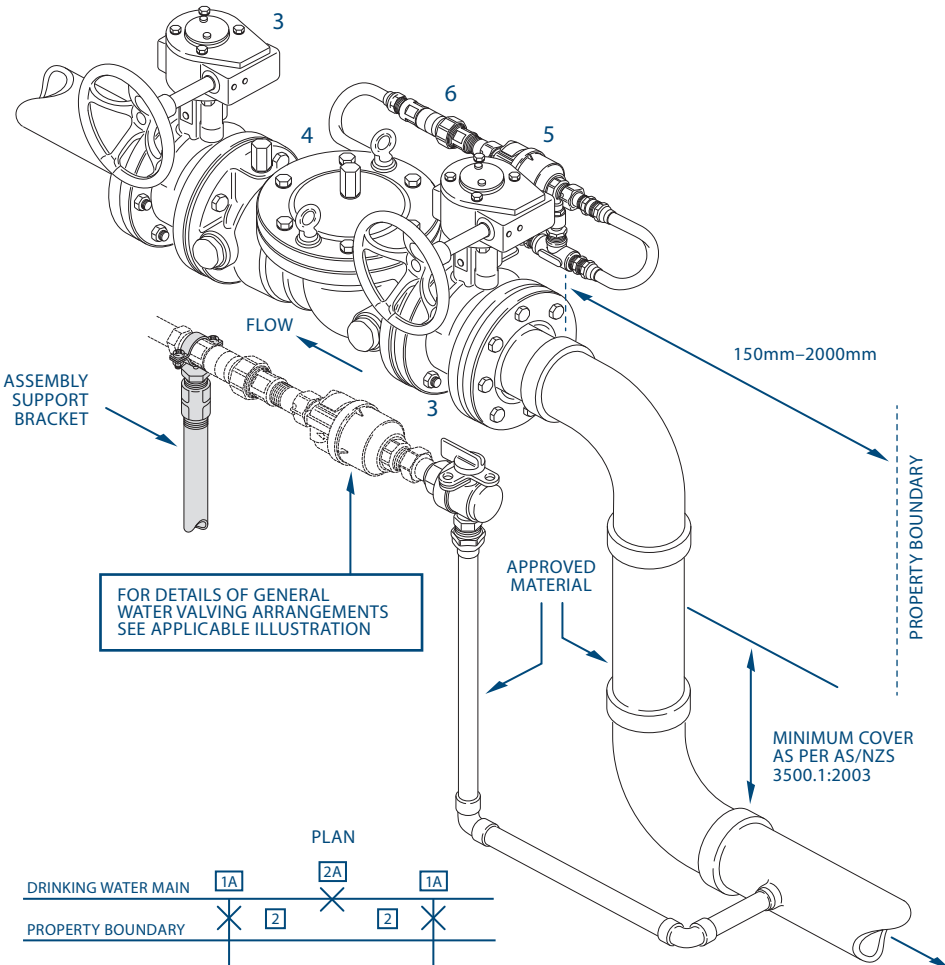

FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE APPLICABLE ILLUSTRATION

STANDARD LEGEND	
⊗	V Valve
○	M Meter
□	D.B. Dirt Box
---	S.P. Straight Piece
⊥	T.F. Testing Ferrule
▭	L.S. Line Strainer
⌌	B.P.D. Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V. Single Check Valve
⌌	T.D.C.V. Testable Detector Check Valve

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1A, 2 & 2A	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	TESTABLE SINGLE SPRING LOADED CHECK VALVE
5	25MM BYPASS METER SUPPLIED BY WESTERN WATER MAY REQUIRE LARGER BYPASS METERS ON A CASE BY CASE BASIS. SEE DRAWING 17
6	25MM DUAL CHECK VALVE

